


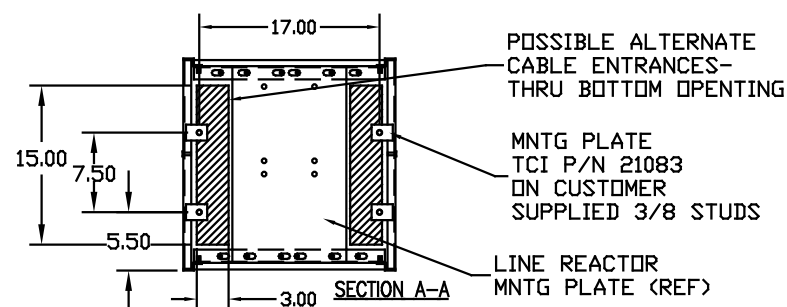
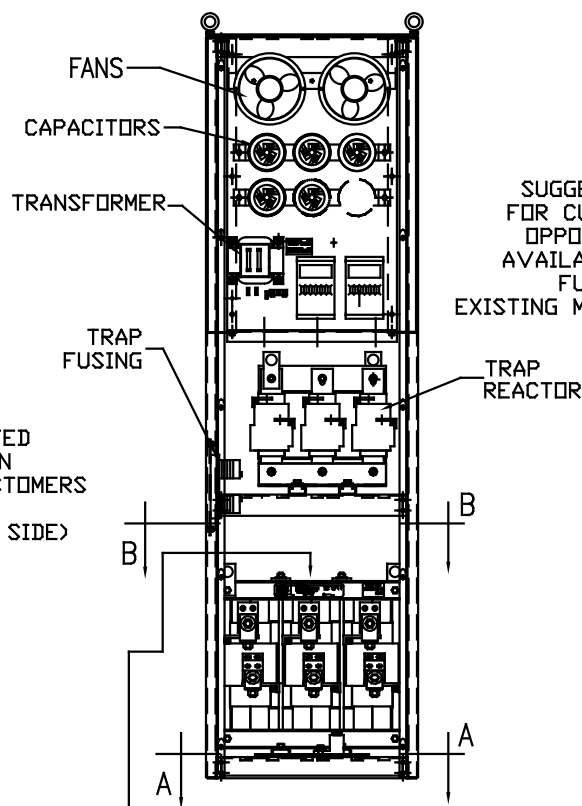


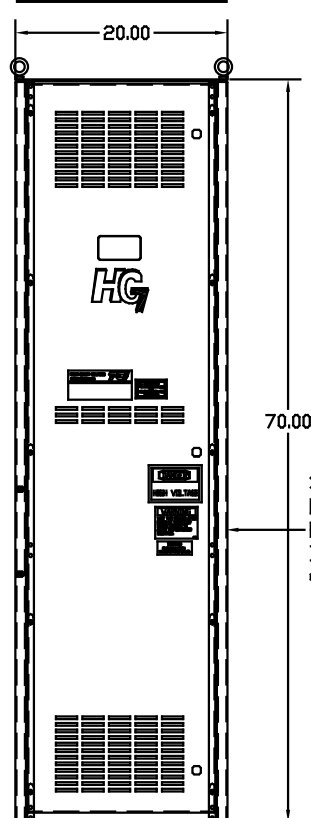


TIGHTENING TORQUE 500 IN-LB.

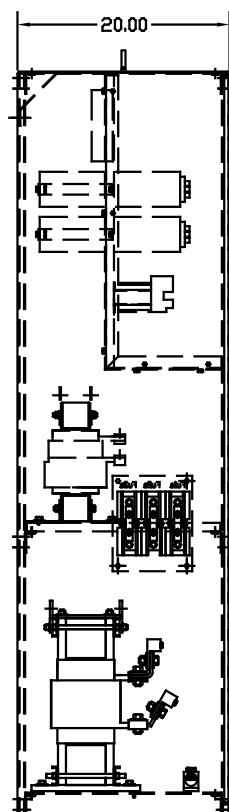

SUGGESTED LOCATION
FOR CUSTOMERS INPUT
OPPOSITE SIDE ALSO
AVAILABLE BY MOVING
FUSES AND TR TO
EXISTING MOUNTING STUDS.

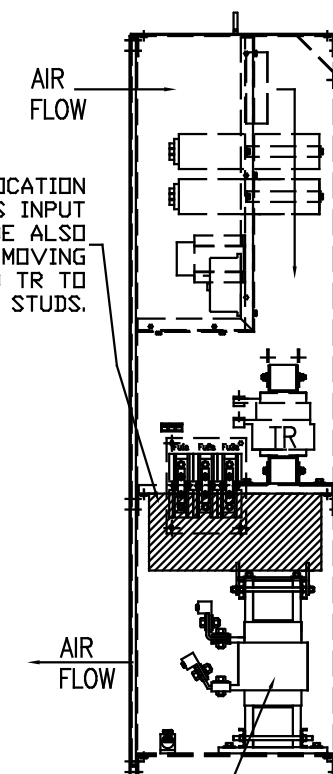

L1	L2	L3
T1	T2	T3



SECTION B-B

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES

					TOLERANCES EXCEPT AS NOTED DECIMAL .XX $\pm$.03 .XXX $\pm$.01 FRACTIONAL $\pm$ 1/32 ANGULAR $\pm$ 1/2°	 7878 N. 86th STREET MILWAUKEE, WI 53224
					HG300AW01STC,HG7, 300HP 480/3/60, W/CONTRACTOR	
NO	REVISION	DATE	BY		DRN. BY DSW DATE 08/04/08 SCALE 1" = 1" APPR. C TIT. FIT.	DRN. NO. 103515DG SHEET 1 OF 1

SYMBOL	TCI PART NUMBER
LR	KDRX1T
TR	KTR90A65HG
CAP1 ,2 ,3 ,4. (20 KVAR)	KCAP20A6B
CAP5. (10 KVAR)	KCAP10A6B
CONTACTORS	19246
XFMR.	23898
Fu1a,2a,3a	11175
Fu4,6	13443
Fu5	16987

UNIT SPECIFICATIONS:					
KVAR	HARMONIC	VOLT	HZ	PHASE	HP
90	5TH	480	60	3	300
ENCLOSURE		NEMA 1- COLOR, BLACK			
FEATURES		W/CONTACTOR			
APPROX.WT. LBS.		600			